User Manual M1

Direct voltage signals shunt 0-60 – 150 mV

Technical features:

- red display of -1999…9999 digits (optional: green, orange or blue display)
- minimal installation depth: 25 mm without plug-in terminal
- adjustment via factory default or directly on the sensor signal
- min-/max-value recording
- 10 adjustable setpoints
- display flashing at threshold exceedance or undershooting
- tara- function
- programming interlock via access code
- protection class IP65 at the front
- plug-in screw terminal
- pc-based configuration software PM-TOOL for devices without keypad, for a simple adjustment of standard devices

Identification

STANDARD TYPES	ORDER NUMBER
Direct voltage Housing size: 96x48 mm	**M1-1VR4B.0002.570BD** **M1-1VR4B.0002.770BD**

Options – breakdown of order code:

	M	1-	1	V	R	4	B.	0	0	0	2.	7	7	0	B	D	

Basic type M-Line

Installation depth
38 mm
incl. plug-in terminal — 1

Housing size
96x48x25 mm
(without plug terminal) — 1

Display type
Voltage, current — V

Display colours
Blue — B
Green — G
Red — R
Orange — Y

Number of digits
4-digit — 4

Digit height
14 mm — B

Interface
Without — 0

Dimension
D physical Unit

Version
B B

Setpoints
0 No setpoints

Protection class
1 without keypad, operation on the back
7 IP65/plug-in terminal

Supply voltage
5 230 VAC
7 24 VDC galv.insulated

Measuring input
2 Shunt 0-60 - 150 mV

Analog output
0 Without

Sensor supply
0 Without

Please state physical unit by order, e.g. V

Contents

1.	Assembly	2
2.	Electrical connection	3
3.	Function and operation description	4
4.	Setting up the device	5
	4.1. Switching on	5
	4.2. Standard parameterization	5
	4.3. Extended parameterization	7
	4.3.1. Min/Max value inquiry „TRST“	8
	4.3.2. Flashing of display „FLAS“	8
	4.3.3. Threshold values „LI-1“ to „LI-2“	8
	4.3.4. Setpoints „SPCT“	9
5.	Factory settings	10
	5.1. Default values	10
	5.2. Reset to default settings	11
6.	Technical data	14
7.	Safety advice	16
8.	Error elimination	17

1. Assembly

Please read the *Safety advice* on *page 16* before installation and keep this user manual for future reference.

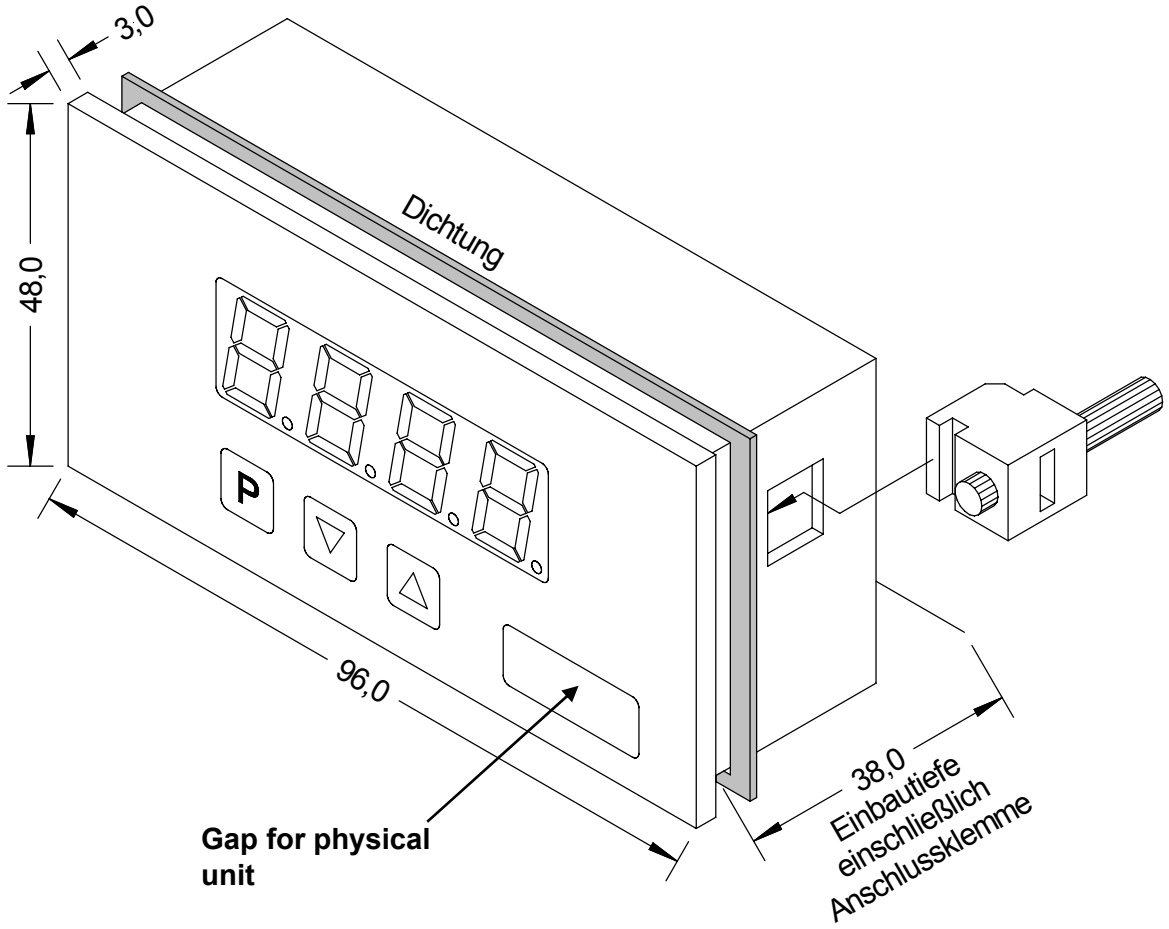

1. After removing the fixing elements, insert the device.
2. Check the seal to make sure it fits securely.
3. Click the fixing elements back into place and tighten the clamping screws by hand. Then use a screwdriver to tighten them another half a turn.

CAUTION! The torque should not exceed 0.1 Nm!

The dimension symbols can be exchanged before installation via a channel on the side!

2. Electrical connection

Type M1-1VR4B.0002.570BD with a supply of 230 VAC

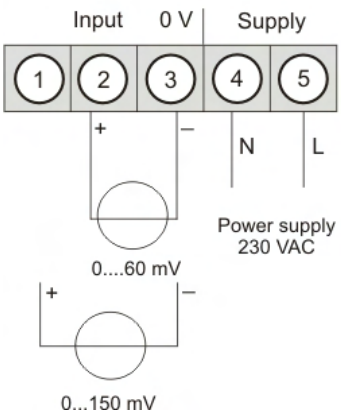

Type M1-1VR4B.0002.770BD with a supply of 24 VDC

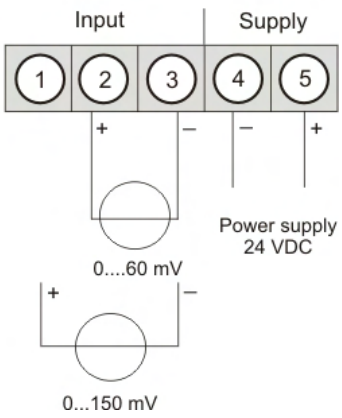

3. Function and operation description

Operation
The operation is divided into two different levels.

Menu Level
Here it is possible to navigate between the individual menu items.

Parameterization level:
The parameters stored in the menu item can be parameterized here.
Functions that can be adjusted or changed are always indicated with a flashing of the display. Adjustments made at the parameterization level should be always confirmed by pressing the **[P]** key to save them.
However, the display automatically saves all adjustments and then switches to operation mode if no further keys are pressed within 10 seconds.

Level	Button	Description
Menu level	P	Change to parameterization level with the relevant parameters
	▲ ▼	For navigation at the menu level
Parameterization level	P	To confirm the changes made at the parameterization level
	▲ ▼	To change the value or setting

Example:

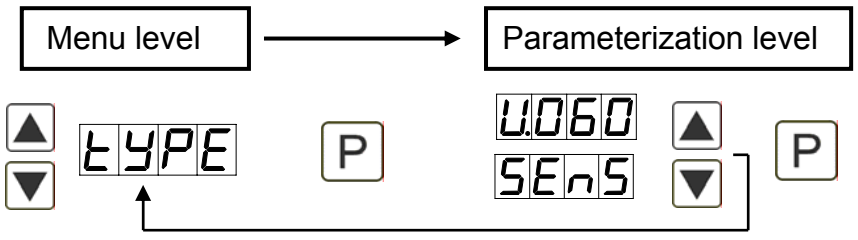

Programming via configuration software PM-TOOL-MUSB6

You receive the software on CD incl. an USB-cable with a device adaptor. The connection is done via a 6-pole micromatch connector plug on the back and the PC is connected via an USB connector plug.

System requirements: PC with USB interface

Software: Windows XP, Windows Vista

4. Setting up the device

4.1. Switching on

Once the installation is complete, you can start the device by applying the current loop. Check beforehand once again that all the electrical connections are correct.

Starting sequence

For 1 second during the switching-on process, the segment test (*8 8 8 8*) is displayed, followed by an indication of the software type and, after that, also for 1 second, the software version. After the start-up sequence, the device switches to operation/display mode.

4.2. Standard parameterization:

To be able to parameterize the display, press the **[P]** key in operating mode for 1 second. The display then changes to the menu level with the first menu item *TYPE*.

Menu level	Parameterization level
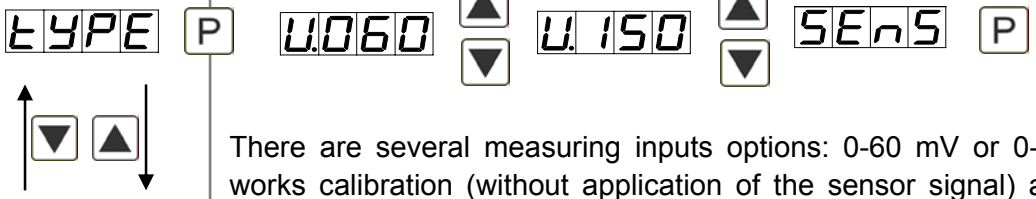	**Selection of the input signal, *TYPE*:** There are several measuring inputs options: 0-60 mV or 0-150 mV signals as the works calibration (without application of the sensor signal) and *SENS* as the sensor calibration (with the sensor applied). Confirm the selection with **[P]** and the display switches back to menu level.
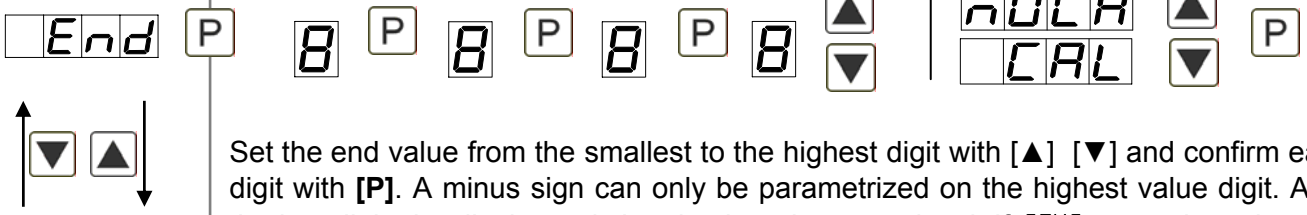	**Setting the measuring range end value, *END*:** Set the end value from the smallest to the highest digit with [▲] [▼] and confirm each digit with **[P]**. A minus sign can only be parametrized on the highest value digit. After the last digit, the display switches back to the menu level. If *SENS* was selected as the input option, you can only select between *NOCA* and *CAL*. With *NOCA*, only the previously set display value is taken over, and with *CAL*, the device takes over both the display value and the analogue input value.
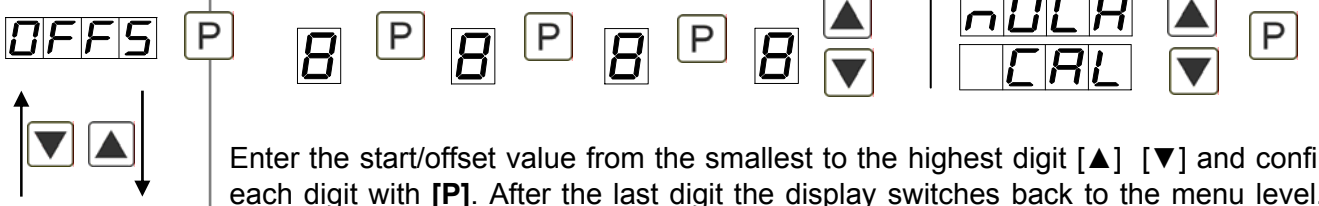	**Setting the measuring range start/offset value, *OFFS*:** Enter the start/offset value from the smallest to the highest digit [▲] [▼] and confirm each digit with **[P]**. After the last digit the display switches back to the menu level. If *SENS* was selected as the input option, you can only select between *NOCA* and *CAL*. With *NOCA*, only the previously set display value is taken over, and with *CAL*, the device takes over both the display value and the analogue input value.

Menu level	Parameterization level
	**Setting the decimal point, *DOT*:**  The decimal point on the display can be moved with [▲] [▼] and confirmed with **[P]**. The display then switches back to the menu level again.
	**Setting the display time, *SEC*:**  The display time is set with [▲] [▼]. The display moves up in increments of 0.1 up to 1 second and in increments of 1.0 to 10.0 seconds. Confirm the selection by pressing the **[P]** button. The display then switches back to the menu level again.
	**Activation / deactivation of the programming lock and completion of the standard parameterization, *RUN*:**  With the aid of the [▲] [▼] keys, you can choose between the deactivated key lock *ULOC* (works setting) and the activated key lock *LOC*. Make the selection with **[P]**. After this, the display confirms the settings with **"- - - -"**, and automatically switches to operating mode. If *LOC* was selected, the keyboard is locked. To get back into the menu level, you must press **[P]** for 3 seconds in operating mode. You must now enter the *CODE* (works setting *1 2 3 4*) that appears using the [▲] [▼] keys plus **[P]** to unlock the keyboard. *FAIL* appears if the input is wrong.

4.3. Extended parameterization

By pressing the [▲] & [▼] buttons during standard parameterization for one second, the display switches to the extended parameterization mode.
Operation is the same as in standard parameterization.

Menu level	Parameterization
	**Rescaling the measuring input values,** *ENDA:* With the aid of this function, you can rescale the input value of **e.g. 50 mV** (works setting) without applying a measuring signal. If sensor calibration has been selected, these parameters are not available.
	**Rescaling the measuring input values,** *OFFA:* With the aid of this function, you can rescale the input value of **e.g. 0.5 mV** (works setting) without applying a measuring signal. If sensor calibration has been selected, these parameters are not available.
	**Setting the tare/offset value,** *TARA:* The given value is added to the linerarized value. In this way, the characteristic line can be shifted by the selected amount.
	. **Zero point tranquilization,** *ZERO:* With zero point tranquilization, a value range around zero can be preselected at which the display shows zero. If, for example, a 10 is set, the display would show a zero in the range from -10 to +10 and continue below it with -11 and above it with +11.

Menu level	Parameterization level
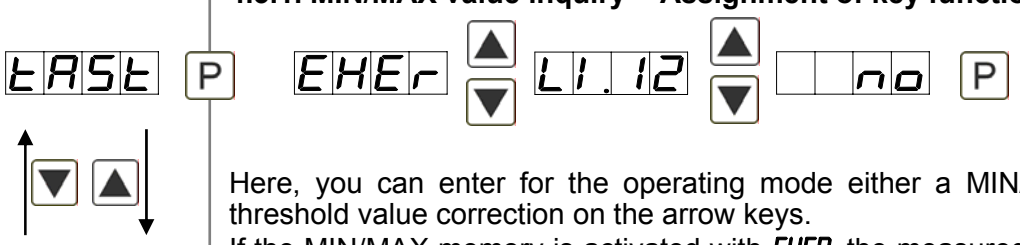	**4.3.1. MIN/MAX value inquiry - Assignment of key functions, *TAST:*** Here, you can enter for the operating mode either a MIN/MAX value inquiry or a threshold value correction on the arrow keys. If the MIN/MAX memory is activated with ***EHER***, the measured MIN/MAX values will be saved during operation and can be called up via the arrow keys **[▲] [▼]**. The values are lost if the device is restarted. If the threshold value correction ***LI.1*** is selected, the limit values can be changed during operation without hindering the operating procedure. If ***NO*** is parameterized, the arrow keys **[▼] [▲]** have no function in operating mode.
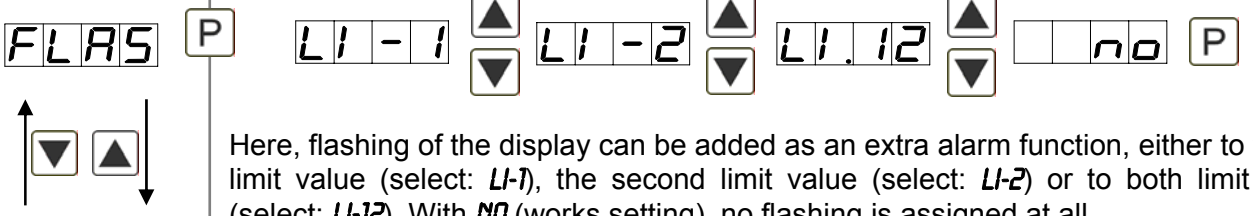	**4.3.2. Flashing of display, *FLAS:*** Here, flashing of the display can be added as an extra alarm function, either to the first limit value (select: ***LI-1***), the second limit value (select: ***LI-2***) or to both limit values (select: ***LI-12***). With ***NO*** (works setting), no flashing is assigned at all.
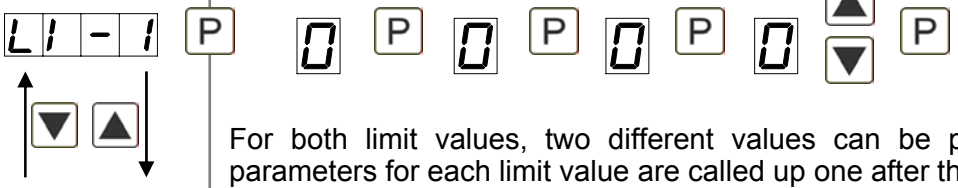	**4.3.3. Limit values / Limits, *LI-1:*** For both limit values, two different values can be parameterized. With this, the parameters for each limit value are called up one after the other.
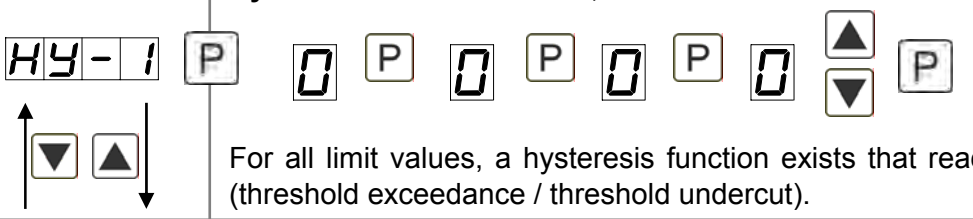	**Hysteresis for limit values, *HY-1:*** For all limit values, a hysteresis function exists that reacts according to the settings (threshold exceedance / threshold undercut).
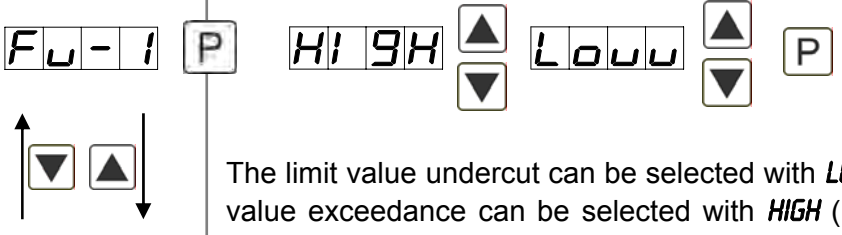	**Function if display falls below / exceeds limit value, *FU-1:*** The limit value undercut can be selected with ***LOUU*** (LOW = lower limit value) and limit value exceedance can be selected with ***HIGH*** (HIGH = upper limit value). If e.g. limit value 1 is on a switching threshold of 100 and occupied with function „*HIGH*“, the alarm will be activated by reaching the threshold. If the limit value is allocated to „*LOW*“, an alarm will be activated by undercut of the threshold.

Menu level	Parameterization level
	**Limit value /Limits,** *LI-2:* For both limit values, two different values can be parameterized. With this, the parameters for each limit value are called up one after the other.
	**Hysteresis for limit values,** *HY-2:* For all limit values, a hysteresis function exists that reacts according to the settings (threshold exceedance / threshold undercut).
	**Function if display falls below / exceeds limit value,** *FU-2:* To indicate if the value falls below the lower limit value, ***LOUU*** can be selected (LOW = lower limit value) and if it goes above the upper limit value, ***HIGH*** can be selected (HIGH = upper limit value). LOW corresponds to the quiescent current principle and HIGH to the operating current principle.
	**Setting the code,** *CODE:* With this setting, it is possible to select an individual code (works setting ***1 2 3 4***) for locking the keyboard. To lock/release the key, proceed according to menu item ***RUN***.
	**4.3.4. Set points - Number of additional set points,** *SPCT:* 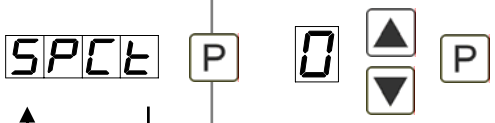 In addition to the start and end value, 8 extra set points can be defined to linearize non-linear sensor values. Only the activated set point parameters are displayed.

Menu level	Parameterization level
	**Display values for set points** *DIS1 ... DIS5:* Under this parameter the setpoints are defined on a value basis. At the sensor calibration one will be asked at the end (like at Endwert/Offset, too), if a calibration shall be triggered.
	**Analogue values for set points** *INP1 ... INP8:* Setpoints are only displayed under works calibration (4-20 mA). Here you can choose your analog values. The entry of constantly rising values need to be done self-contained.

Functional principle of the set points

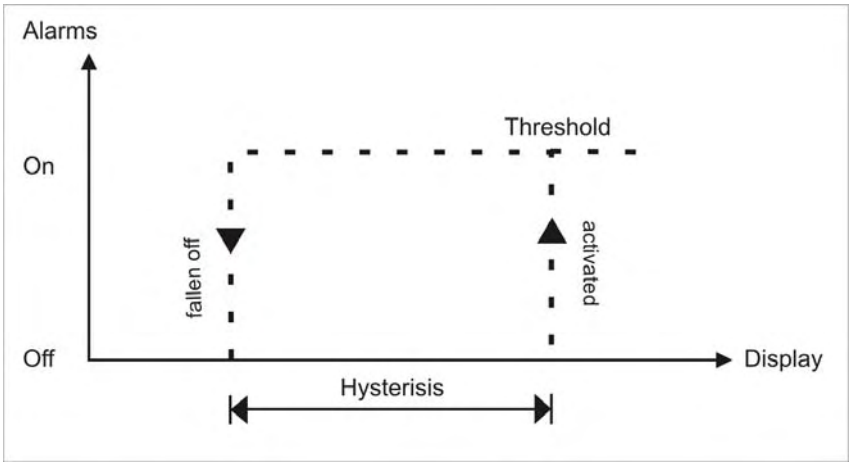

Limit value exceedance "HIGH"

By limit value exceedance the alarm S1-S2 is off below the threshold and on on reaching the threshold.

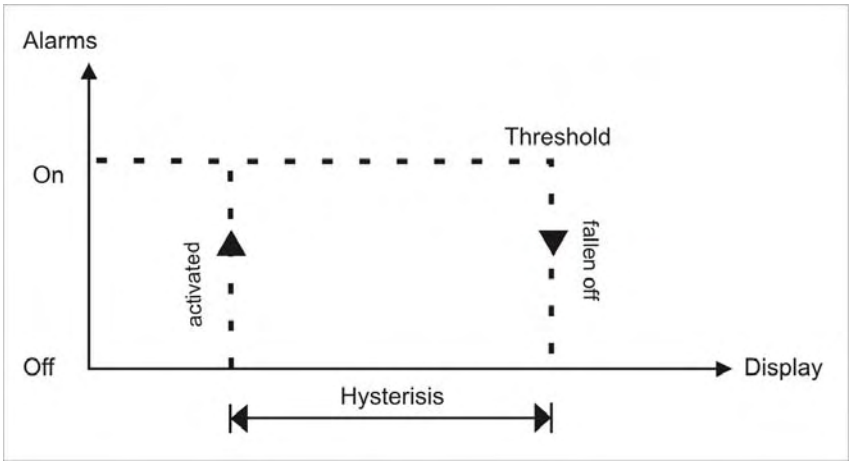

Limit value undercut "LOW"

By limit value undercut the alarm S1-S2 is on below the threshold and switched off on reaching the threshold.

Alarms / optical setpoint display

An activated set point can be optically indicated by flashing of the 7-segment display.

Functional principle of the alarms	
Alarm	Deactivated, display value
Threshold	Threshold/limit value for switch over
Hysteresis	Width of the window between the thresholds
Function	Limit value exceedance / limit value undercut

5. Factory settings

5.1. Default values

Parameter	Menu items				Default
tYPE	U.060	SEnS	U. 150		SEnS
End	-999	to	9999		1000
OFFS	-999	to	9999		0000
dot	0000	to	0.000		0
SEC	0.1	to	10.0		01.0
run	ULOC	LOC			ULOC
OFFA	-99.9	to	99.9		
EndA	-99.9	to	99.9		
tArA	-9.99	to	9999		0000
2Er0	00	to	99		0
tASt	no	EHtr	LI.12		no
FLAS	no	LI -1	LI -2	LI 12	no
LI -1	-999	to	9999		0200
HY-1	0000	to	9999		0000
Fu-1	Louu	HI 9H			HI 9H
LI -2	-999	to	9999		0300
HY-2	0000	to	9999		0000
Fu-2	Louu	HI 9H			HI 9H
CodE	0000	to	9999		1234
SPCt	0	to	8		0
dI S1	-999	to	9999		
InP1	-999	to	9999		
dI S2	-999	to	9999		
InP2	-999	to	9999		
dI S3	-999	to	9999		
InP3	-999	to	9999		
dI S4	-999	to	9999		
InP4	-999	to	9999		
dI S5	-999	to	9999		
InP5	-999	to	9999		
dI S6	-999	to	9999		
InP6	-999	to	9999		

Parameter	Menu items				Default
dI S7	-999	to	9999		
InP7	-999	to	9999		
dI S8	-999	to	9999		
InP8	-999	to	9999		

5.2. Reset to default values

To return the unit to a **defined basic state**, a reset can be carried out to the default values.

The following procedure should be used:

- Switch off the power supply
- Press button [**P**]
- Switch on voltage supply and press **[P]-**button until „- - - -“ is shown in the display.

With reset, the default values of the program table are loaded and used for subsequent operation. This puts the unit back to the state in which it was supplied.

Caution! All application-related data are lost.

6. Technical data

Housing				
Dimensions				
96x48	96x48x25 mm (BxHxD)			
	96x48x38 mm (BxHxD) including plug-in terminal			
Panel cut-out				
96x48	$92.0^{+0.8}$ x $45.0^{+0.6}$ mm			
Insulation thickness	up to 3 mm			
Fixing	snap-in screw element			
Material	PC Polycarbonate, black, UL94V-0			
Sealing material	EPDM, 65 Shore, black			
Protection class	standard IP65 (front), IP00 (back side)			
Weight	approx. 100 g			
Connection	plug-in terminal; wire cross section up to 2.5 mm^2			
Display				
Digit height	14 mm			
Segment colour	red			
Display range	-1999 to 9999			
Setpoints	optical display flashing			
Overflow	horizontal bars at the top			
Underflow	horizontal bars at the bottom			
Display time	0.1 to 10.0 seconds			
Input	**Measuring range**	**Ri**	**Measuring fault**	**Digit**
min. -5…max. 80 mV	0 – 60 mV	12 kΩ	0.2 % of measuring range	±1
min. -10…max. 180 mV	0-150 mV	30 kΩ	0.2 % of measuring range	±1
Temperature drift	100 ppm / K			
Measuring time	0.1…10.0 seconds			
Measuring principle	U/F-conversion			
Resolution	approx. 18 Bit at 1s measuring time			
Power pack	230 VAC +/- 10 % max. 6 VA 24 VDC +/- 10 % max. 1 VA			
Memory	EEPROM			
Data life	≥ 100 years			

Ambient conditions	
Working temperature	0…60°C
Storing temperature	-20…80°C
Weathering resistance	relative humidity 0-80% on years average without dew
EMV	EN 61326
CE-sign	Conformity to directive 2004/108/EG
Safety standard	According to low voltage directive 2006/95/EG EN 61010; EN 60664-1

7. Safety advice

Please read the following safety advice and the assembly *chapter 1* before installation and keep it for future reference.

Proper use

The **M1-device** is designed for the evaluation and display of sensor signals.

Danger! Careless use or improper operation can result in personal injury and/or damage to the equipment.

Control of the device

The panel meters are checked before dispatch and sent out in perfect condition. Should there be any visible damage, we recommend close examination of the packaging. Please inform the supplier immediately of any damage.

Installation

The **M1-device** must be installed by a suitably **qualified specialist** (e.g. with a qualification in industrial electronics).

Notes on installation

- There must be no magnetic or electric fields in the vicinity of the device, e.g. due to transformers, mobile phones or electrostatic discharge.
- The **fuse rating** of the supply voltage should not exceed a value of **6A N.B. fuse**.
- Do not install **inductive consumers** (relays, solenoid valves etc.) near the device and **suppress** any interference with the aid of RC spark extinguishing combinations or free-wheeling diodes.
- Keep input, output and supply lines separate from one another and do not lay them parallel with each other. Position “go” and “return lines” next to one another. Where possible use twisted pair. So, you receive best measuring results.
- Screen off and twist sensor lines. Do not lay current-carrying lines in the vicinity. Connect the **screening on one side** on a suitable potential equaliser (normally signal ground).
- The device is not suitable for installation in areas where there is a risk of explosion.
- Any electrical connection deviating from the connection diagram can endanger human life and/or can destroy the equipment.
- The terminal area of the devices is part of the service. Here electrostatic discharge needs to be avoided. Attention! High voltages can cause dangerous body currents.
- Galvanic insulated potentials within one complex need to be placed on a appropriate point (normally earth or machines ground). So, a lower disturbance sensibility against impacted energy can be reached and dangerous potentials, that can occur on long lines or due to faulty wiring, can be avoided.

8. Error elimination

	Error description	Measures
1.	The unit permanently indicates overflow. 	• The input has a very high measurement, check the measuring circuit. • With a selected input with a low voltage signal, it is only connected on one side or the input is open. • Not all of the activated setpoints are parameterised. Check if the relevant parameters are adjusted correctly.
2.	The unit permanently shows underflow. 	• The input has a very low measurement, check the measuring circuit . • With a selected input with a low voltage signal, it is only connected on one side or the input is open. • Not all of the activated setpoints are parameterised. Check if the relevant parameters are adjusted correctly.
3.	The word "*HELP*" lights up in the 7-segment display.	• The unit has found an error in the configuration memory. Perform a reset on the default values and re-configure the unit according to your application.
4.	Program numbers for parameterising of the input are not accessible.	• Programming lock is activated • Enter correct code
5.	"*ERR1*" lights up in the 7-segment display	• Please contact the manufacturer if errors of this kind occur.
6.	The device does not react as expected.	• If you are not sure if the device has been parameterised before, then follow the steps as written in *chapter 5.2.* and set it back to its delivery status.